



Fire Marshal's Office
San Mateo County Fire
CAL FIRE

320 PAUL SCANNELL DRIVE, SAN MATEO, CALIFORNIA 94402 (650) 573-3846

DATE: DEC. 13, 2011

REVISED:


NUMBER: CFS-011

Title: *Bollard/Guardpost*

Approved: Clayton Jolley

Bollard/Guardpost

Construction Guidelines:

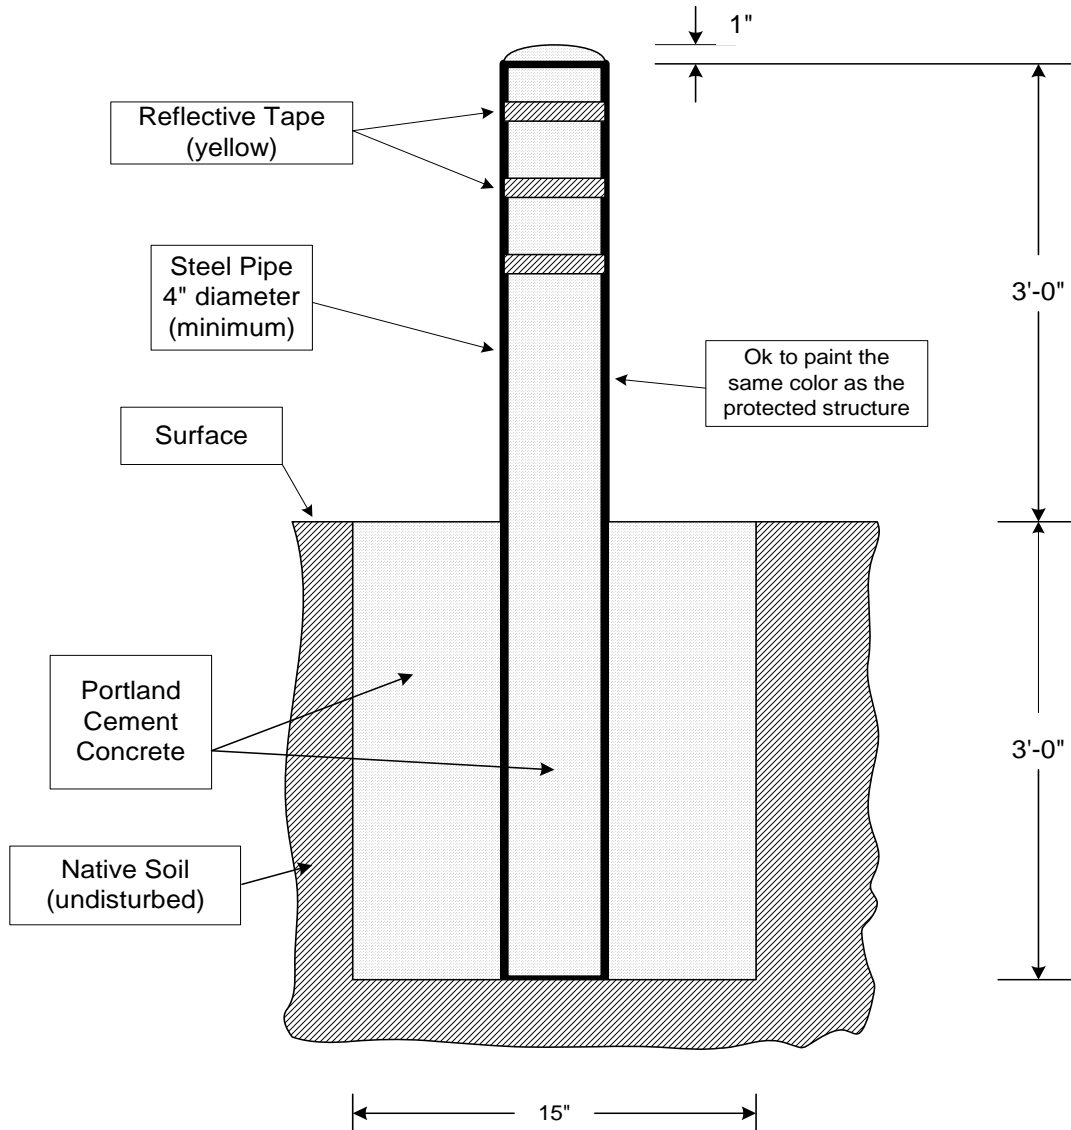

NOTE: Guard posts shall be spaced not more than 4' on center.